


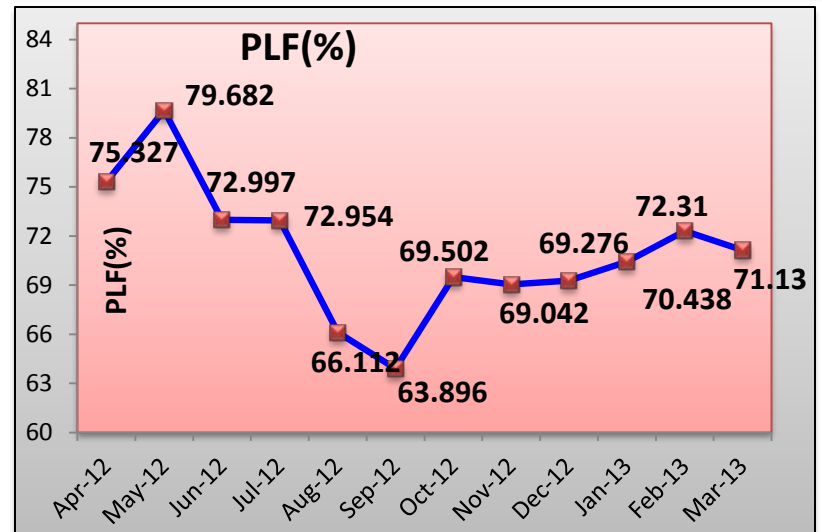


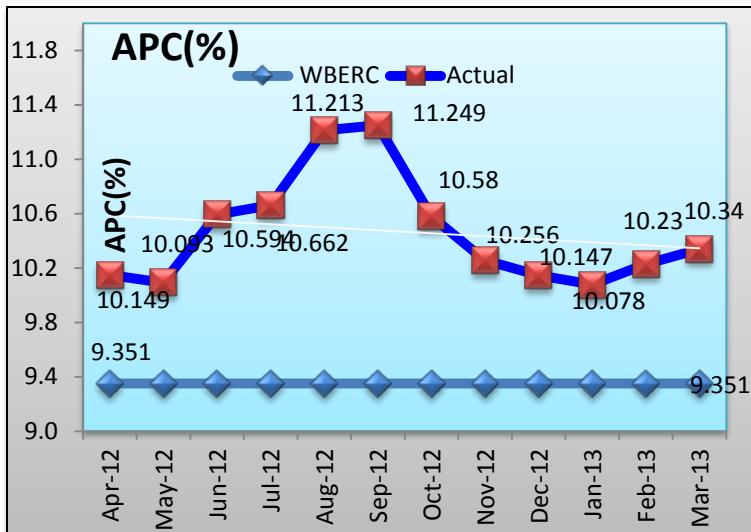

WBPDCL's Performance from April 2012 to March 2013

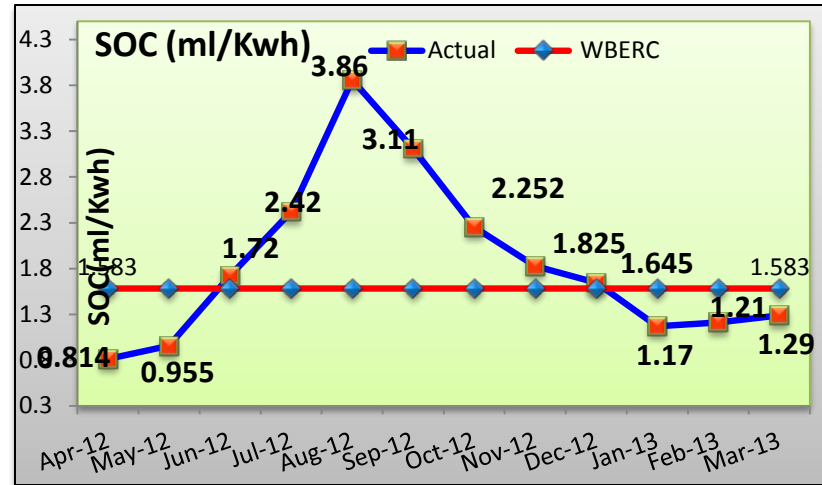

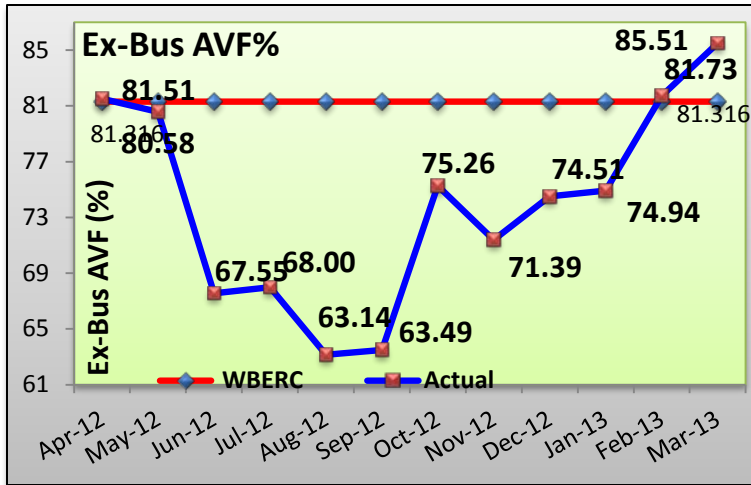

WBPDCL's Performance from April 2012 to March 2013

WBPDCL : Performance Comparison 2012-13 and 2011-12 (Upto March)

DESCRIPTION	KOLAGHAT THERMAL POWER STATION		BAKRESWAR THERMAL POWER STATION		BANDEL THERMAL POWER STATION		SANTALDIH THERMAL POWER STATION		SAGARDIGHI THERMAL POWER STATION		WBPDCL		
	2012(April-Mar)	2011(April-Mar)	2012(April-Mar)	2011(April-Mar)	2012(April-Mar)	2011(April-Mar)	2012(April-Mar)	2011(April-Mar)	2012(April-Mar)	2011(April-Mar)	2012(April-Mar)	2011(April-Mar)	
Generation (MU)	7350.159	7560.883	8004.145	7725.426	1859.58	1862.101	2410.483	2581.597	3896.394	4078.031	23520.761	23808.038	
PLF (%)	66.592	68.31	87.020	83.761	47.174	47.108	55.034	78.230	74.132	77.376	69.56	72.55	
Backdown (MU)	460.01	210.01	402.31	230.96	141.900	57.97	218.52	94.11	199.20	84.63	1421.94	677.68	
Deemed PLF(%)	71.250	70.428	91.861	86.529	51.242	48.769	60.58	81.39	78.419	79.196	74.255	74.857	
APC (%)	10.52	10.22	9.64	9.55	11.53	11.67	10.09	9.71	11.59	11.749	10.435	10.32	
Ex-bus Availability (MU)	7219.27	6921.83	7624.67	7166.27	1855.45	1667.11	2344.10	2400.92	3708.73	3644.06	22752.21	21800.19	
Ex-bus Availability (%)	72.43	69.34	91.093	85.38	52.328	46.94	58.81	79.95	77.540	75.980	74.228	73.34	
Oil Rate (ml/kwh)	2.218	2.484	1.000	0.996	5.306	6.560	2.171	2.732	1.292	2.067	1.889	2.275	
Coal Rate (kg/kwh)	0.823	0.842	0.660	0.657	0.844	0.881	0.663	0.698	0.667	0.717	0.727	0.748	
Number of shutdowns	Planned	7	4	5	3	3	2	1	0	2	1	18	10
	Total Forced	80	62	38	28	69	58	31	44	29	34	247	226
	BTL	18	15	5	2	25	20	10	8	11	5	69	50
	LSD	14	3	3	4	7	2	0	0	2	1	26	10
Availability Factor (%)	87.20	87.48	95.51	92.94	71.57	71.63	60.95	85.47	87.11	91.72	84.23	90.63	
Loading Factor (%)	76.367	78.094	91.109	90.128	65.909	65.766	90.30	91.53	85.099	84.36	82.589	80.054	